


NOTES
ALL DIMENSIONS TO BE TAKEN ON SITE
NO DIMENSIONS TO BE SCALED FROM DRAWING
THIS DRAWING TO BE READ IN CONJUNCTION WITH ALL
OTHER RELEVANT DRAWINGS, SPECIFICATIONS ETC.
ALL WORKS TO COMPLY WITH CURRENT BUILDING
REGULATIONS WHETHER DETAILED OR NOT.

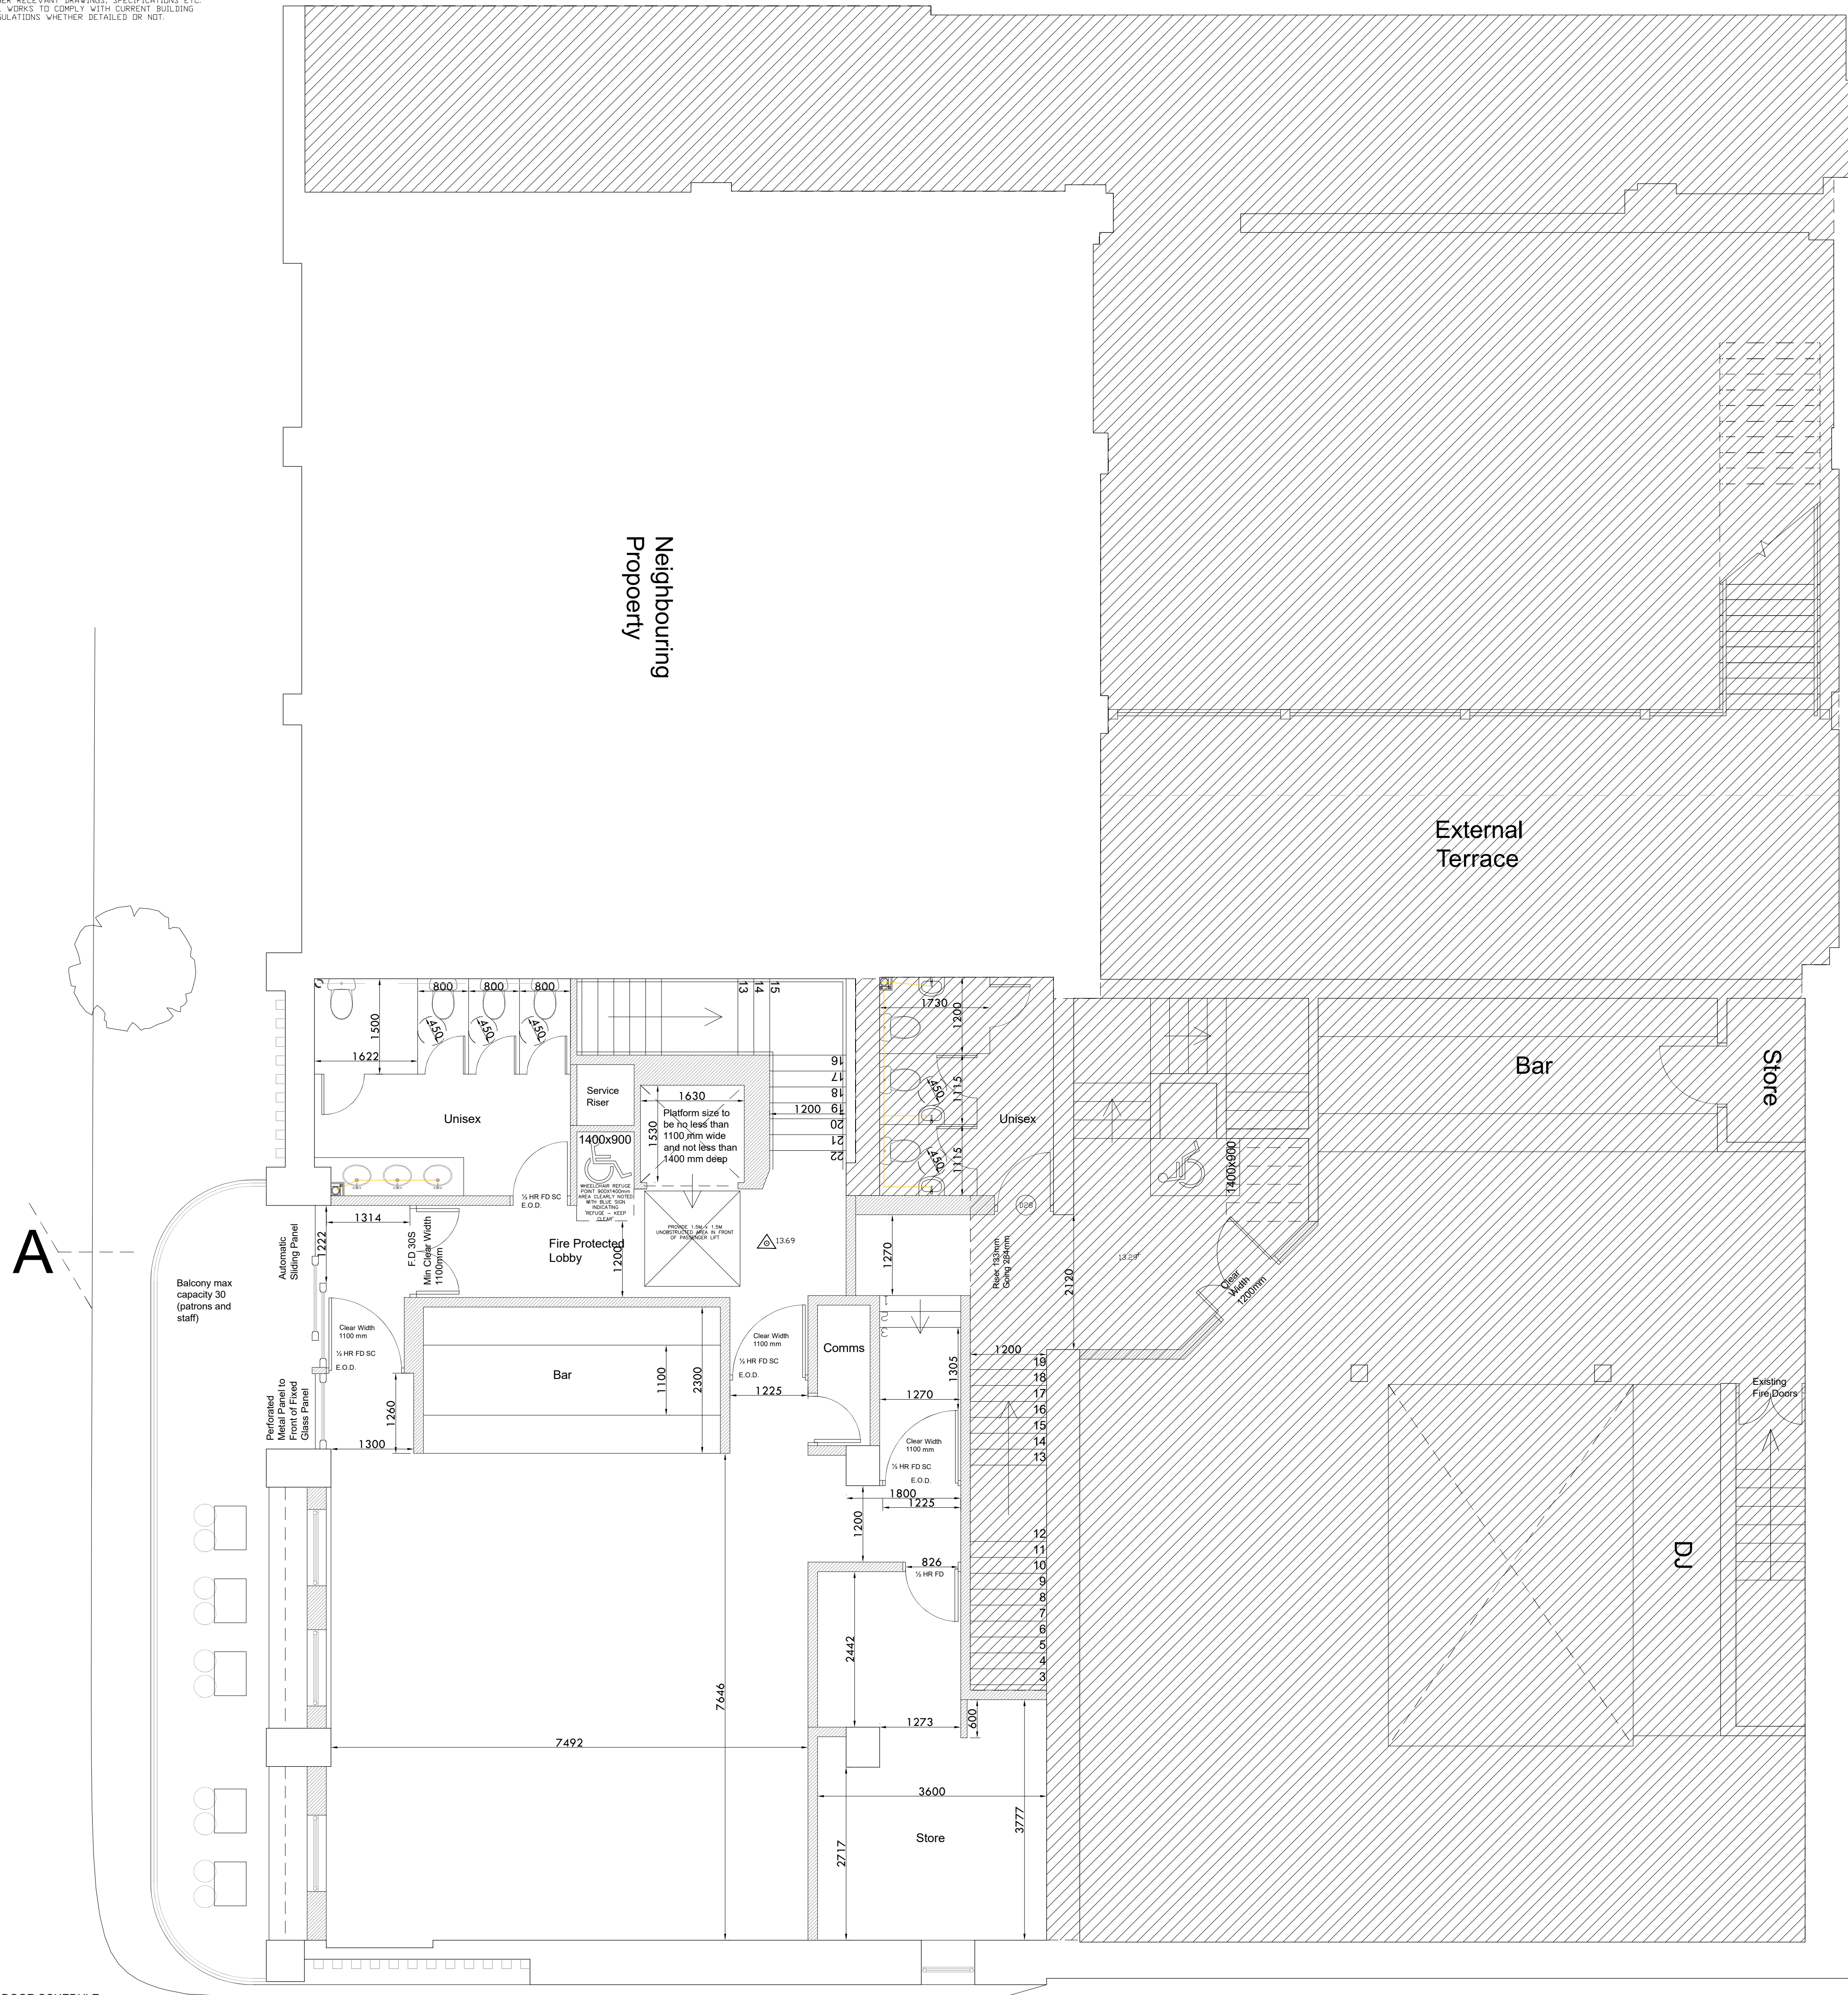

DOOR		EXISTING NEW	FLOOR	SC	EOD
D1	EXISTING		GF	-	YES
D2	NEW		GF	-	YES
D3	EXISTING	GF	GF	YES	YES
D4	EXISTING		GF	YES	YES
D5	EXISTING		GF	-	-
D6	EXISTING		GF	-	-
D7	EXISTING		GF	-	-
D8	NEW		GF	-	-
D9	NEW		GF	-	-
D10	NEW		GF	-	-
D11	NEW		GF	-	-
D12	EXISTING		GF	YES	YES
D13	EXISTING		GF	YES	YES
D14	EXISTING		GF	-	-
D15	EXISTING		GF	-	-
D16	EXISTING		GF	-	-
D17	EXISTING		GF	-	-
D18	EXISTING		GF	-	YES
D19	EXISTING		GF	-	YES
D20	EXISTING		GF	-	-
D21	EXISTING		GF	-	-
D22	EXISTING		GF	-	-
D23	EXISTING		GF	-	YES
D24	NEW		GF	YES	-
D25	NEW		GF	-	-
D26	EXISTING		GF	-	-
D27	NEW		FF	YES	YES
D28	NEW		FF	-	-
D29	EXISTING		FF	YES	-
D30	EXISTING		FF	-	-
D31	EXISTING		FF	YES	YES
D32	NEW		FF	-	-
D33	EXISTING		FF	-	-
D34	NEW		GF	YES	YES
D37	NEW		GF	YES	-
D38	NEW		GF	YES	-

ANY NEW DOORS ON ESCAPE ROUTES WILL ONLY BE FITTED WITH SIMPLE FASTENING DEVICES, AND THE DOORS WILL BE EASILY OPENABLE WITHOUT THE USE OF A KEY. PANIC BOLTS COMPLYING WITH BS EN 1225 WILL BE FITTED TO EMERGENCY ONLY FINAL EXIT DOORS WHICH ARE NOT USED FOR FREQUENT ENTRY AND EXIT.

ANY ELECTRICALLY POWERED ACCESS CONTROL LOCKS, I.E. MAGNETIC LOCKS ON ESCAPE ROUTES WILL BE ARRANGED TO RETURN TO THE UNLOCKED POSITION AS FOLLOWS:

- ON OPERATION OF THE FIRE ALARM AND
- ON LOSS OF POWER OR SYSTEM ERROR, AND
- ON ACTIVATION OF A MUSEUM UNIT (TYPE A) CONFORMING TO BS EN 54 PART 11 (2001) POSITIONED AT THE DOOR ON THE SIDE APPROACHED BY PEOPLE MAKING THEIR ESCAPE. WHERE THE DOOR PROVIDES ESCAPE IN EITHER DIRECTION, A UNIT SHOULD BE INSTALLED ON BOTH SIDES OF THE DOOR.

A GLAZED VISION PANEL, OR PANELS OF NOT LESS THAN 0.1M², SHOULD BE PROVIDED IN A DOOR THAT SUBDIVIDES A CORRIDOR, OR WHERE A DOOR SWINGS BOTH WAYS. THE VISION PANEL OR PANELS SHOULD INCLUDE -

- (A) A LOWER ZONE OF VISIBILITY NOT MORE THAN 500mm TO NOT LESS THAN 800mm; AND
- (B) AN UPPER ZONE OF VISIBILITY NOT MORE THAN 1150mm TO NOT LESS THAN 1500mm, MEASURED FROM THE FLOOR AND LOCATED TOWARDS THE LEADING EDGE OF THE DOOR

Diagram 6.1 Wheelchair accessible unisex
sanitary accomodation
see paras 6.12 and 6.23




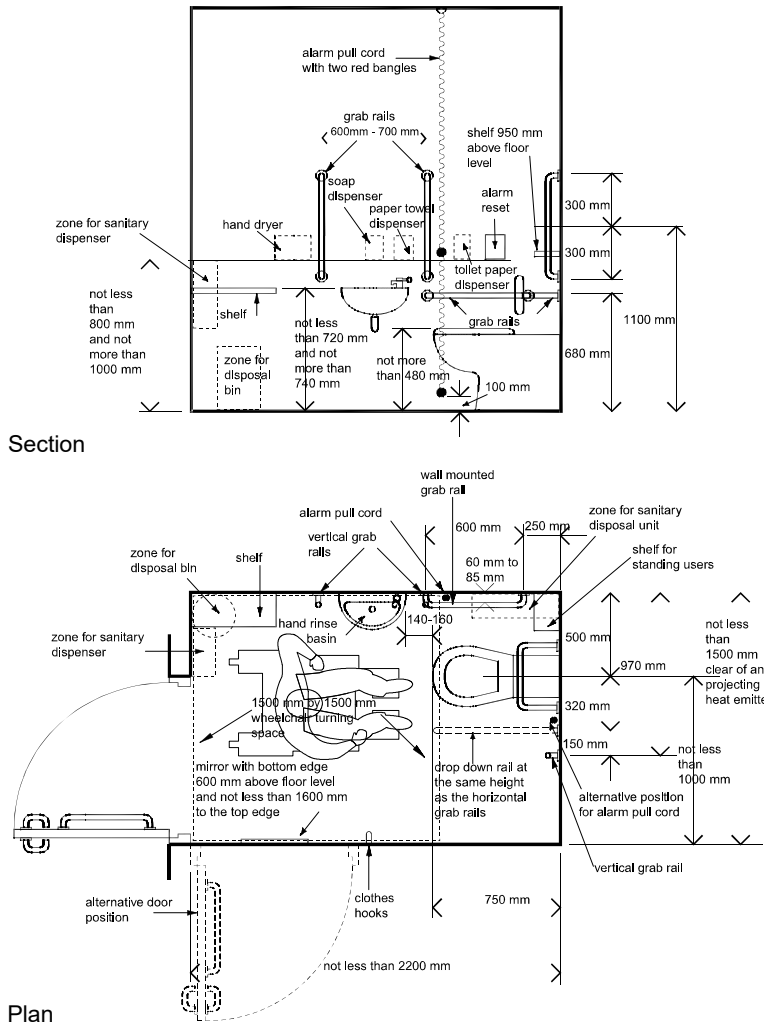


Diagram 6.3 Watercloset Compartments
see paras 6.13, 6.14 and 6.22

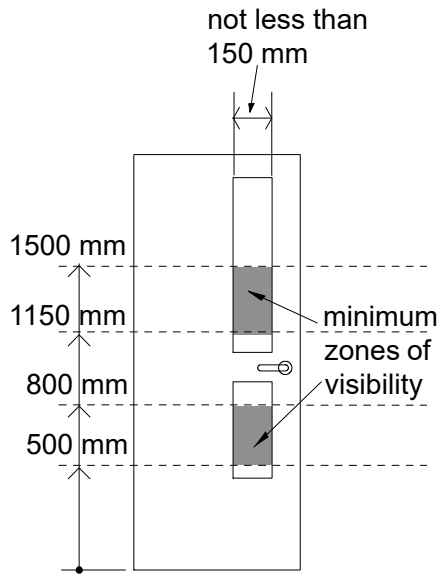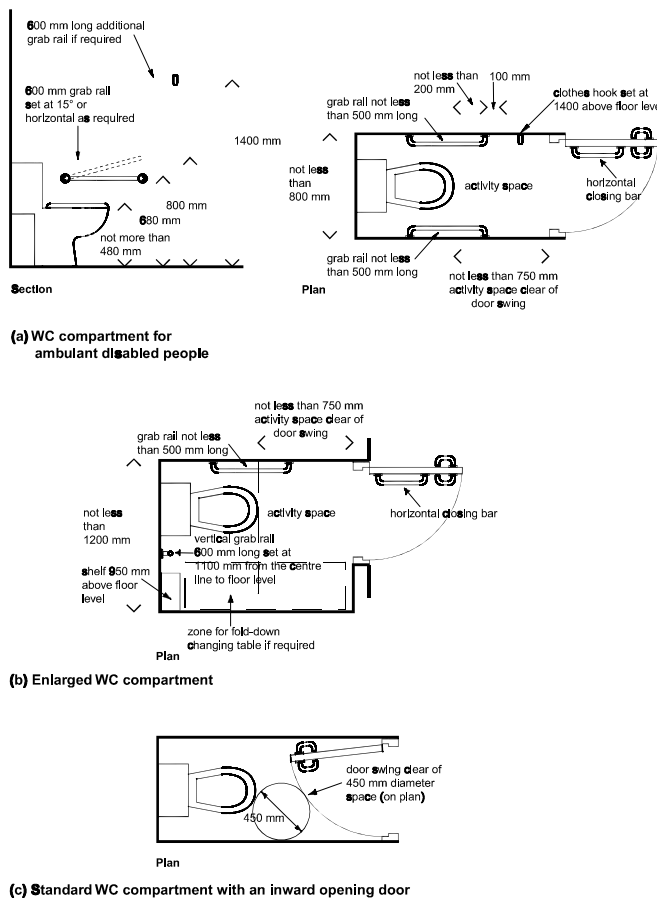

VISION PANELS TO DOORS ON CIRCULATION ROUTES

HEIGHTS OF SWITCHES & SOCKET OUTLETS. (NON-DOMESTIC)
WALL MOUNTED SOCKET OUTLETS AND SWITCHES (OTHER THAN ISOLATORS) IN THE ENTRANCE STOREY TO BE LOCATED NOT MORE THAN 1200mm AND NOT LESS THAN 450mm ABOVE FINISHED FLOOR LEVEL.
THE CORD OF A PULL CORD SWITCH TO TERMINATE NOT MORE THAN 1200mm ABOVE FINISHED FLOOR LEVEL.

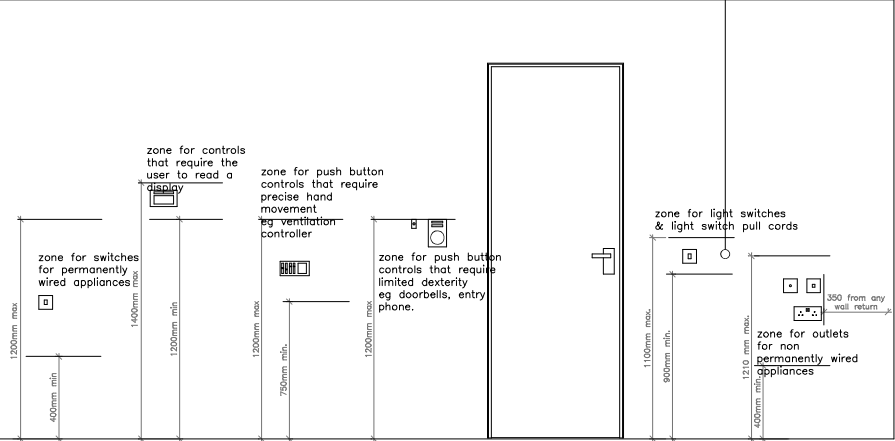

Date	Rev.	Description
------	------	-------------

NOTES: ALL DIMENSIONS TO BE CHECKED ON SITE.
NO DIMENSIONS TO BE SCALED FROM DRAWINGS


McCreanor Company Architects
© copyright mccreanor & co. architects
 [mccreanorandcoarchitects](#)
 [@mccreanorandcoarchitects](#)


www.mccreanorandcoarchitects.com
 Tel: 028 3883 2711

Project
Refurbishment of 51-53, Upper Arthur Street, Phase 3
Client
Endless Music Ltd.
Drawing Title
Proposed First Floor Plan, Phase 3

Scale / Paper Size	Drawn By	Checked By	Date
1:50 / A1	Jr		12/02/26
Drawing No.			Revision
MCCA / 19 / 121C/ BC 03			C